




Ridgewood House
The Ridge
Chipping Sodbury
Bristol
BS37 6AY

Particle Size Distribution Report

Product: 2/6mm Limestone Single Size
Material Code: 70000009
Supplied by: Whatley
Customer:
Site:
Ticket Number:
Testing Laboratory: Whatley
Material type: HGS / Limestone
Job Type: 100/General
Test Method: Dry sieving entire sample
(To BS EN 933-1 : 2020)

Sampled to: BSEN 932-1 : 1997
Prepared to: BSEN 932-2 : 1997

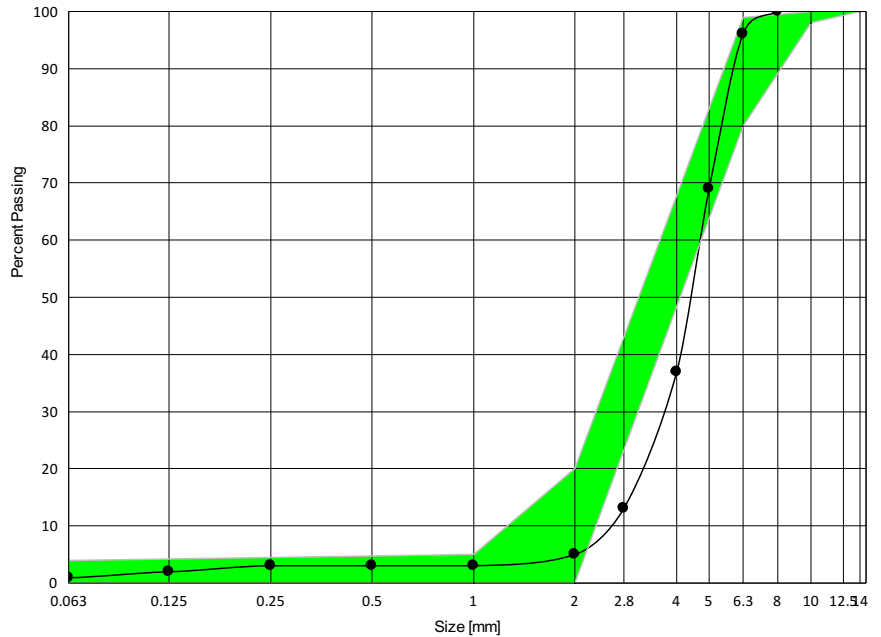

Sample Information	
Sample number	AGG-54251
Sampled by	Samuel Griffiths
Date Sampled	28/02/2022
Date Tested	28/02/2022
Sample location	Blend 120
Moisture Content (%)	1.0
Flakiness Index	17
Flakiness Specification	35
Compliance Specification	Yes
Remarks	

Sieve Size (mm)	Percentage Passing (%)	Spec limits (%)	Complies
20	100	-	-
16	100	-	-
14	100	100	Yes
12.5	100	-	-
10	100	98 - 100	Yes
8	100	-	-
6.3	96	80 - 99	Yes
5	69	-	-
4	37	-	-
2	5	0 - 20	Yes
1	3	0 - 5	Yes
0.5	3	-	-
0.25	3	-	-
0.125	2	-	-
0.063	1.0	0 - 4.0	Yes

Results shown on this report only relate to the sample being tested and at no point did the laboratory deviate from the test method as stated above.

Signed: Area Technical Manager

Issue Date :10/03/2022