




Ridgewood House
The Ridge
Chipping Sodbury
Bristol
BS37 6AY

Particle Size Distribution Report

Product: Type 3 Limestone Sub-base
Material Code: 70005235
Supplied by: Whatley
Customer:
Site:
Ticket Number:
Testing Laboratory: Whatley
Material type: HGS / Limestone
Job Type: 100/General
Test Method: Wash entire sample
(To BS EN 933-1 : 2020)

Sampled to: BSEN 932-1 : 1997
 Prepared to: BSEN 932-2 : 1997

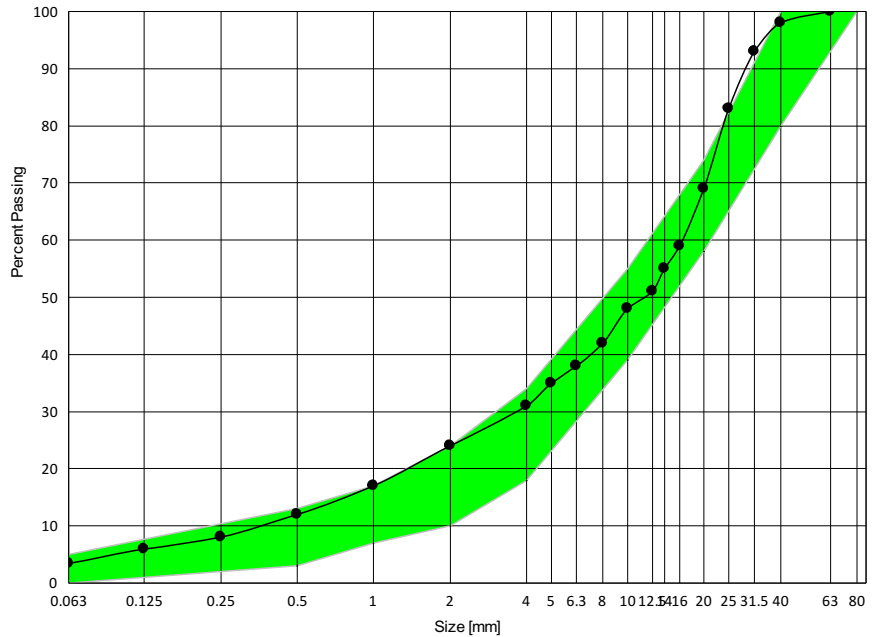

Sample Information

Sample number	AGG-55518
Sampled by	Chris Keepen
Date Sampled	01/03/2022
Sample location	Stockpile
Moisture Content (%)	5.3

Additional Grading Requirements - Type 1 GSB table 8/7

Size fraction (d/D)	% passing	Specification	Complies (Spec)
1/2	7	4.0 to 15.0	yes
2/4	7	7.0 to 20.0	yes
4/10	17	10.0 to 25.0	yes
10/20	21	10.0 to 25.0	yes

Remarks

Sieve Size (mm)	Percentage Passing (%)	Spec limits (%)	Complies
63	100	-	-
40	98	80 - 100	Yes
31.5	93	-	-
25	83	-	-
20	69	58 - 74	Yes
16	59	-	-
14	55	-	-
12.5	51	-	-
10	48	39 - 55	Yes
8	42	-	-
6.3	38	-	-
5	35	-	-
4	31	18 - 34	Yes
2	24	10 - 24	Yes
1	17	7 - 17	Yes
0.5	12	3 - 13	Yes
0.25	8	-	-
0.125	6	-	-
0.063	3.5	0 - 5.0	Yes

Results shown on this report only relate to the sample being tested and at no point did the laboratory deviate from the test method as stated above.

Signed: Area Technical Manager

Issue Date :10/03/2022